


# Tank Farm Monitoring Using Multiple LEVELtrol II's with RS485 Modbus RTU

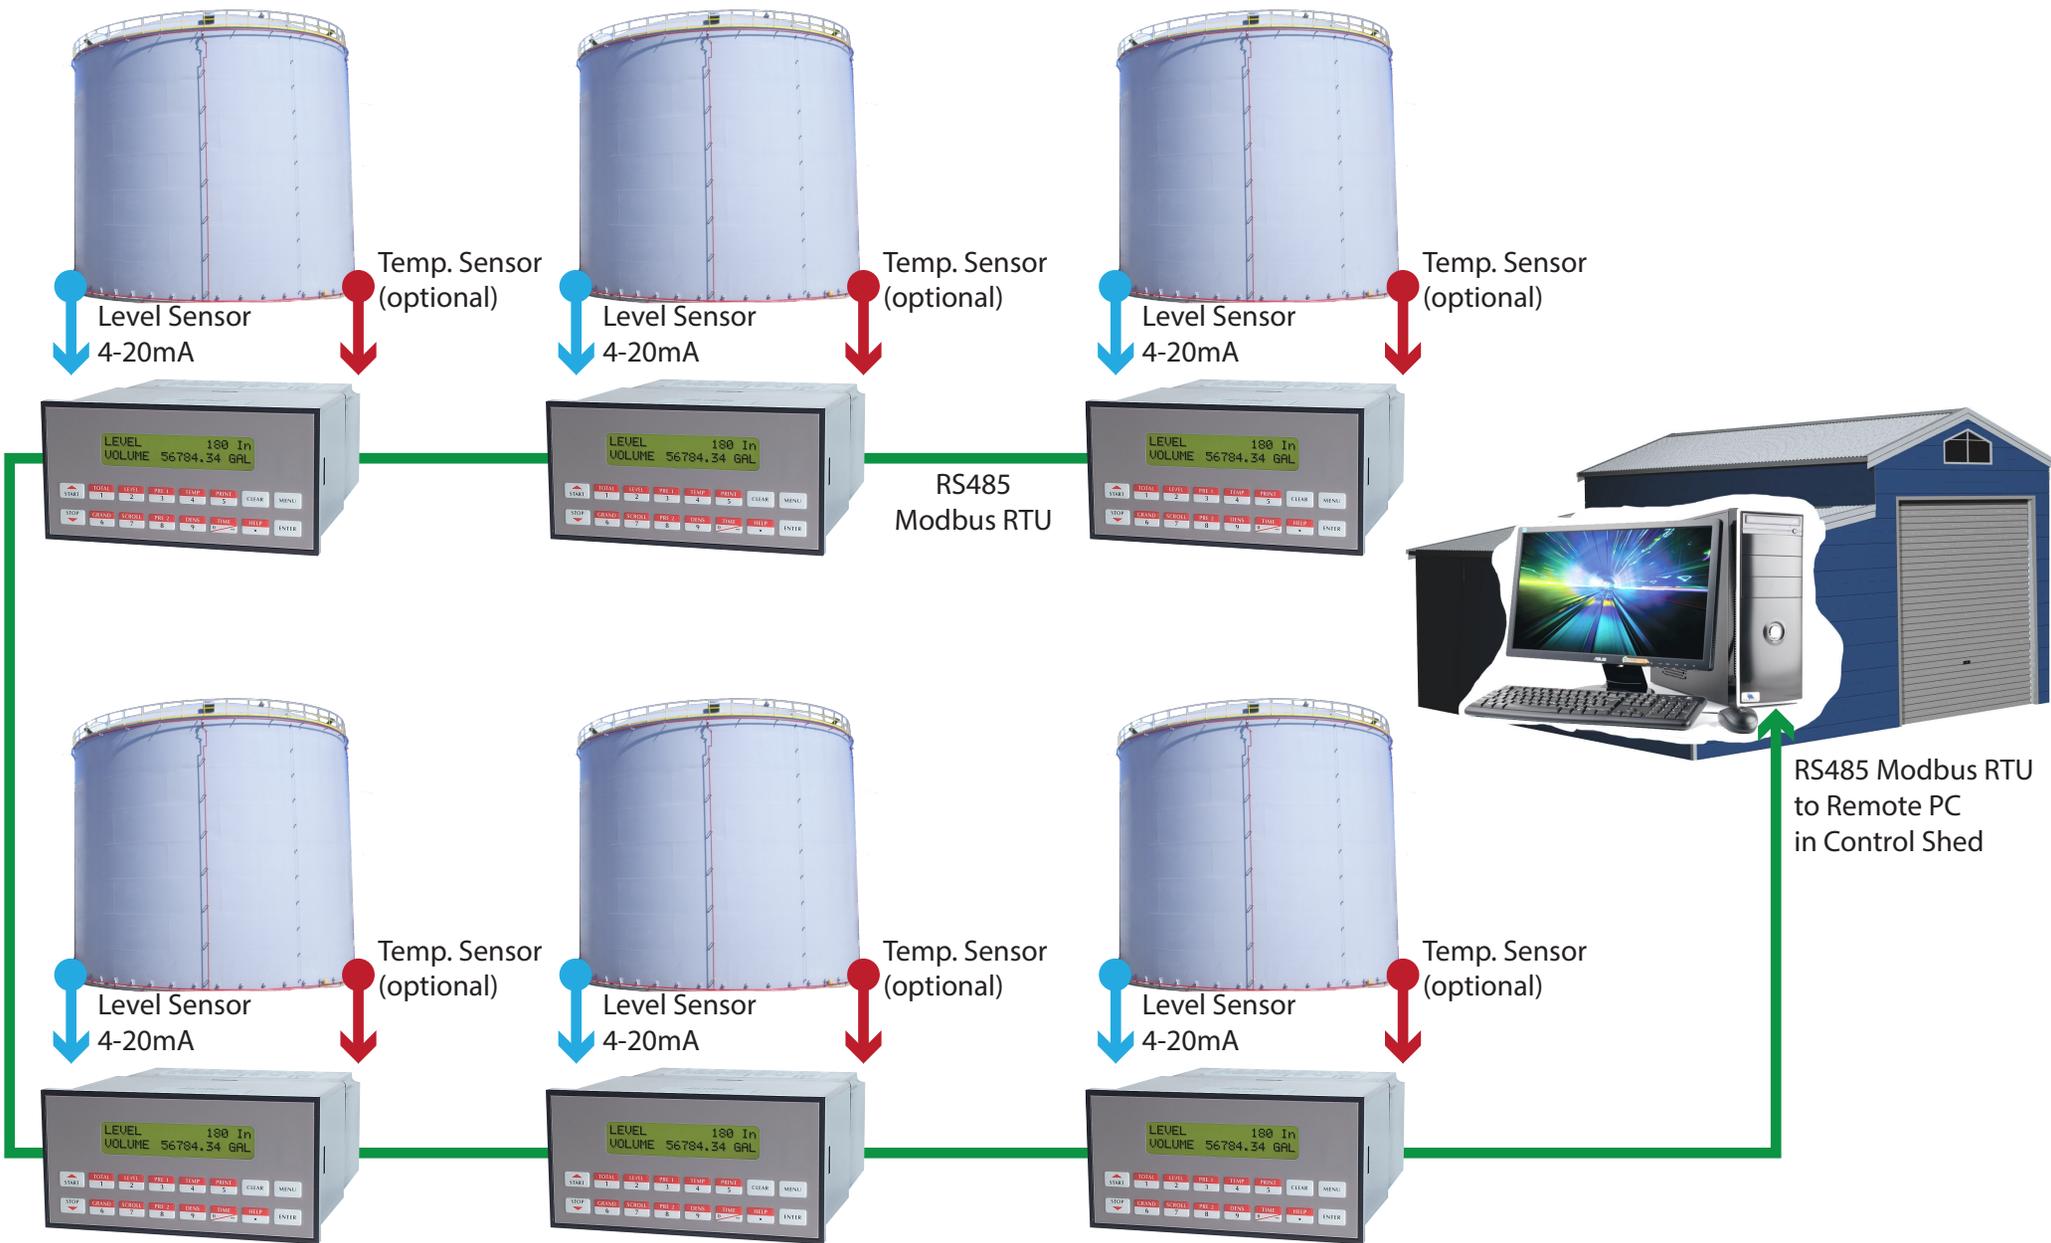

Each tank being monitored is equipped with a level sensor (temperature sensor optional). The level signal from each tank is sent to a LEVELtrol II Level Display Monitor. Each LEVELtrol II is connected to a Modbus RTU network and connected to a remote PC. Information from each LEVELtrol II can be accessed from the PC using TROLLink or Infilink HMI Software.